


TOWN OF ELIZABETH WATER SYSTEM NOTICE

Under the 2021 Lead and Copper Rule Revisions (LCRR), water systems must provide people with specific information about their service lines. This requirement begins on **October 16, 2024**. Since this is a new regulatory requirement, EPA recommends water systems plan ahead to ensure readiness to comply with the new requirement. Below the Village of Elizabeth has provided information and an overview of the EPA's requirements. It is important that our consumers know if the water they are receiving has been delivered through a lead, galvanized requiring replacement (GRR), or lead status unknown service line. This information is intended to help owners and/or occupants make decisions on what actions to take to reduce their exposure to lead in drinking water.

The Town of Elizabeth Water System is working to identify service line materials throughout the water system and we are required to determine the type of material (called a service line) that connects your home, building, or other structure to the water main.

Required Classification of Each Service Line

1. **"Lead"** where the service line is made of lead.
2. **"Galvanized Requiring Replacement"** where a galvanized service line is or was at any time downstream of a lead service line or is currently downstream of a "Lead Status Unknown" service line.
3. **"Non-lead"** where the service line is determined through an evidence-based record, method, or technique not to be lead or galvanized requiring replacement. The water system may classify the actual material of the service line (i.e., plastic or copper) as an alternative to classifying it as "Non-lead."
4. **"Unknown"** where the service line material is not known to be lead, galvanized requiring replacement, or a non-lead service line, such as where there is no documented evidence supporting material classification.

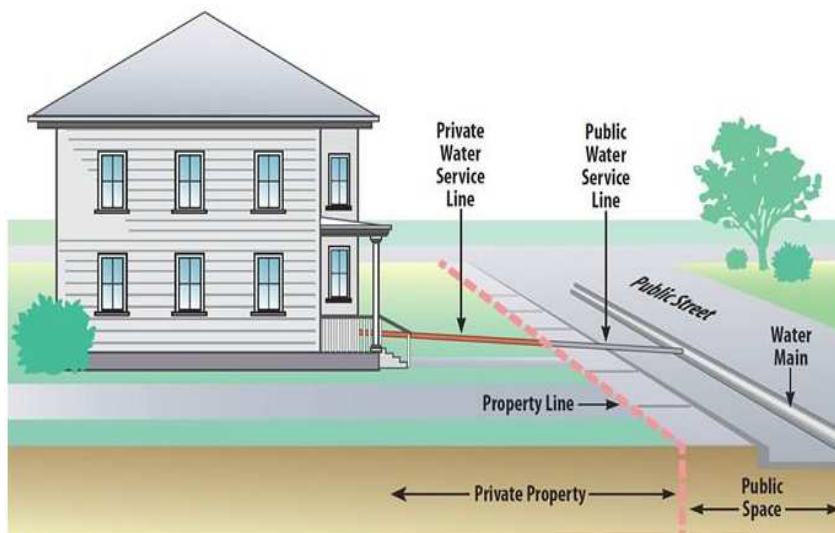

To help the Water System to determine the material of your service line the EPA has developed an online step-by-step guide to help people identify lead pipes in their homes called Protect Your Tap: Once the service line has been determined **PLEASE CALL** us at 318-634-5100 during office hours so we can update our records.

Notices Date: 08/04/2026



PROTECT YOUR TAP
a quick check for lead


Use this online guide to help you identify lead pipes and reduce lead exposure in drinking water.

www.epa.gov/protectyourtap

Testing your home's drinking water is the only way to know if lead is present.



More information about testing your water for lead:
www.epa.gov/safewater

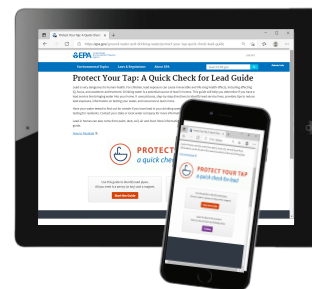

SCAN ME

